


Low voltage AC drives for HVAC applications



# Smile to the Environment

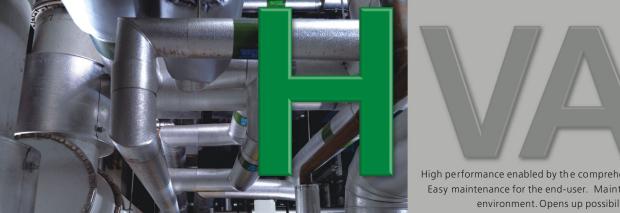

High performance enabled by the comprehensive use of Fuji technology. Easy maintenance for the end-user. Maintains safety and protects the environment. Opens up possibilities for the new generation.



# Large Contribution to Reducing Global Warming (Environmental Protection) with Energy Saving

50% of energy consumption in office buildings is related to air conditioning. The FRENIC HVAC series is the dedicated inverter for HVAC that features functions and performances offer the optimal thermal environment for the people working in the building by keeping the energy

consumption in various devices (compressor, condenser water pump, AHU and others) to the minimum. Fuji Electric contributes largely to global environment by realizing carbon dioxide reduction with energy saving by the inverter.

## Wide variation in model capacity

Model can be selected from two model types.

Standard type (EMC filter built-in type)

0.75 to 710kW (Protective structure IP21 or IP55 can be selected with the model between 0.75 and 90kW.)

DCR built-in + EMC filter built-in type

0.75 to 90kW (Protective structure IP21 or IP55 can be selected with the model between 0.75 and 90kW.)

Inverter capacity	EMC filter	DC reactor	Protective structure
0.75kW to 90kW	Built-in	Built-in	IP21/IP55
110kW to 710kW	Built-in	External	IP00

## Optimal control with energy-saving function

- Linearization function
- Temperature difference constant control and pressure difference constant control
- Energy saving functions including wet-bulb temperature presumption control
- Automatic energy-saving operation

## Slim body

The first slim body design among the Fuji Electric inverters. The size is the same for IP21 and IP55.

#### Functions suitable for HVAC use


- 4PID control Fire mode (forced operation)
- Pick-up operation function Real time clock
- Torque vector control Filter clogging prevention function
- Customized logic
   User friendly, useful keypad
- Password function





## Significant Energy Saving Realized!!

For an air-conditioning heat source system, the needed quantity of the cooling or heating water fluctuates generally in seasons or days and nights. Therefore, operations continuing in a water conveyance pressure constant control may lead to high operating unnecessary pressures on terminals at low operating state. Thus, the pump consumes an ineffectual electric power for maintaining the high water conveyance pressure. FRENIC-HVAC can perform an estimated terminal pressure control by linearization function which estimates target pressure from load flow rate. It is possible to reduce the ineffectual pump power consumption and to achieve a great energysaving effect together with maintaining comfortable current air conditioning.

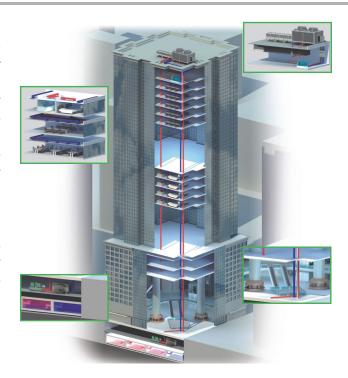

## **Optimum Control for HVAC Facilities**

#### Cooling tower fan

The cooling tower fan is used to cool the heat of cooling water by emitting it into the air. The fan speed is adjusted optimally according to the cooling water temperature at the outlet. Moreover, the inverter estimates the wet-bulb temperature automatically to control the fan so that the temperature of cooling water (wet bulb) is interlocked to the air temperature. (Wet-bulb temperature presumption control)



#### Cooling water pump

The cooling water pump circulates the cooling water to the cooling tower in order to cool the heat generated by the freezing machine. The pump speed is adjusted optimally according to the temperature and flow rate of cooling water. Moreover, the inverter can control the cooling pump so that the difference of cooling water temperature at between the inlet and outlet becomes always constant. (Temperature difference constant control)



#### Chilled water pump

The chilled water pump circulates the chilled water generated with the freezing machine to the air conditioner and fan coil. The pump speed is adjusted optimally according to the header pressure. Moreover, the pump conveyance pressure can be controlled to proper value by converting the flow rate signal to the target pressure using the linearization function. (Linearization function)



#### • Supply fan / Return fan

The speed of supply and return fans is adjusted optimally according to the pressure, discharge temperature, room temperature, and others. Moreover, the highest level of carbon dioxide is selected automatically by detecting the level in room to control it to stay within the allowable level.



## **Optimal Structure Design**

## **User friendly keypad**

• The regulator is indicated by enlarging the LCD.

1. Present value (PV)

5. Output current

9. Power consumption

2. Setting value (SV)

6. Output voltage

10. Cumulative energy

3. Manipulating value (MV)

7. Torque

4. Frequency

8. Rotation speed

\*Possible to show understandable indications through the unit conversion function.



STATUS

Multi-language supported: 19 languages + user customized language

Language										
Japanese	English	Chinese	German	French						
Spanish	Italian	Russian	Greek	Turkish						
Malay	Vietnamese	Thai	Indonesian	Polish						
Czech	Swedish	Portuguese	Dutch							

## Real time clock (RTC) is provided as standard.

- Alarm information with date and time
  - Alarm information for last ten times is stored and displayed with date and time.


Easy failure analysis

#### • Timer function

- Possible to set up to four timers a week.
- Possible to set flag holidays (20 days a year).


Example

When operation is performed in the same schedule through a week



Operation schedule can be set according to actual condition by using four timers.

When operation schedule varies depending on the day of the week



#### Unit conversion function between PV and SV values

• Unit conversion allows you to easily set data.

Function		Units										
	No conversion	%	r/min	kW	m³/s							
	m³/min	m³/h	L/s	L/min	L/h							
Unit conversion	Pa	kPa	MPa	mbar	bar							
	mmHg	psi	mWG	inWG	К							
	°C	°F	ppm									

<sup>\*</sup>Multi-language function: 19 languages + user customized language supported




#### FRN 0.75 AR1 M - 4 E Series name:FRN Destination: E:Europe Standard applicable Input power supply: motor capacity 4:400V Protection structure: Applied for: HVAC M:IP21 L:IP55 S:IP00

#### 1 User-friendly, easy to see dedicated keypad

Multi-language supported, HELP function featured, unit setting with SV and PV values, data copy (three kinds), detachable and can be attached on the panel (using an optional cable)

## 4 Capacitor board

Outputs the life prediction signal determining capacitor capacity drop and cumulative running

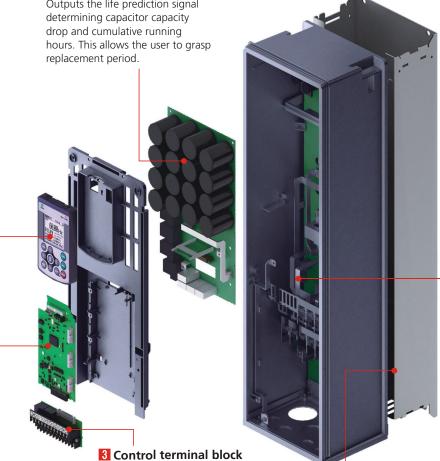

### **5** Cooling fan

Easy replacement just by simply removing and attaching the part. Life prolongation is possible by controlling ON and OFF.

#### 6 EMC filter

Drastically reduces noise. Provided to units of all capacities. Conforming to IEC61800-3.

The detachable control terminal block is adopted. This allows the unit to be replaced easily without disconnecting cables.

#### 2 Control board

USB port equipped.

Max. three types of built-in optional boards can be mounted all together. Optional battery connection

Various communications options

Standard equipment	Optional equipment
BACnet MS/TP	<ul><li>LonWorks</li><li>DeviceNet</li></ul>
• Modbus RTU	• Ethernet • CANopen
• Metasys N2	• Profibus • CC-Link

#### 7 DCR

Drastically reduces harmonic noise. Conforming to IEC/EN61000-3-2 and IEC/EN61000-3-12. Provided as standard (to models up to 90kW), and can be attached externally as an option (to models from 110kW to 710kW).

#### 8 Environmental immunity

3C2, IEC60721-3-3 supported

#### Others


Support/analysis software by loader, RTC backup by battery (option)

## **Functions Suitable for HVAC Use**

## **Linearization function**

This function estimates the target pressure using the load flow rate, which allows the estimated terminal pressure to be controlled. For an air-conditioning heat source system, the needed quantity of the cooling or heating water fluctuates generally in seasons or days and nights. Therefore, operations continuing in a water conveyance pressure constant control may lead to high operating unnecessary pressures on terminals at low operating state. Thus, the pump consumes an

ineffectual electric power for maintaining the high water conveyance pressure. Based on the calculated value and water conveyance pressure of estimated terminal pressure using the detected load flow rate, PID control is performed. It is possible to reduce the ineffectual pump power consumption and to achieve a great energy-saving effect together with maintaining comfortable current air conditioning.

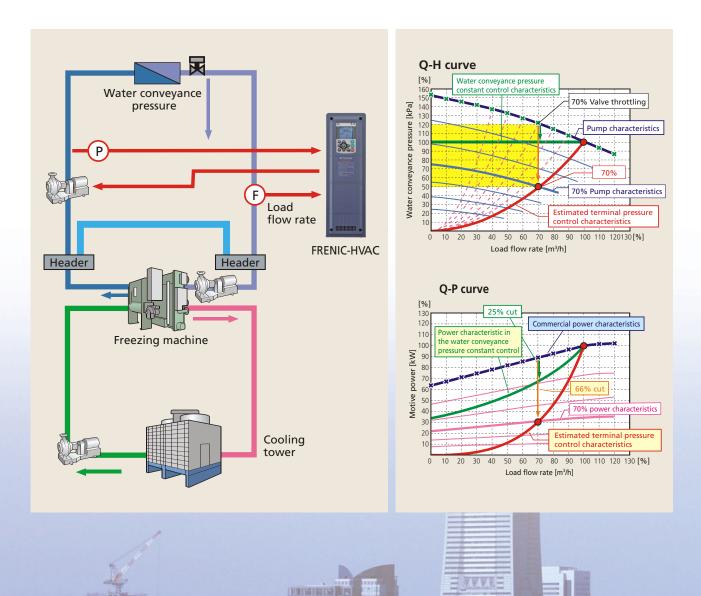




## Wet-bulb temperature presumption control

This function is optimal for controlling the fan of cooling tower. Since the wet-bulb temperature would become higher than the set temperature when the air temperature is particularly high, water temperature will not reach the set temperature. Therefore, the fan keeps rotating at high speed, failing in energy-saving operation. FRENIC-HVAC automatically estimates the wet-bulb temperature and controls the fan so that the cooling water is interlocked with the air temperature in order not to use unnecessary electric power.


## Filter clogging prevention function

This function detects clogging of the fan filter with dust or other materials using the output current and pressure sensor value. When clogging is detected, the fan is rotated in reverse to eject dust, and then resumes rotation in forward to blow air. In addition, the function notifies you of maintenance necessity with the alarm signal.



## **Customized logic**

The customized logic interface function is provided to the inverter body. This enables forming of logic circuit and arithmetic circuit to the digital and analog input and output signals, allowing simple relay sequence to be built while processing the signals freely. 14 steps can be used.

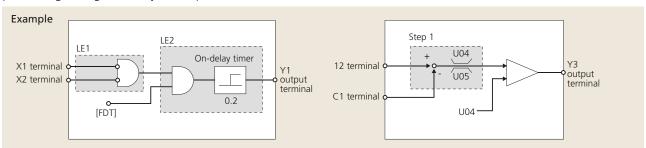

#### Standard 4PID control

The 4PID control is featured as standard. One PID module is used to control the output frequency of the inverter, and the other three PIDs can be used to control the external system. To utilize all of four PIDs, the optional card (OPC-AIO) needs to be mounted.

#### **Password**

Function codes can be read/write, displayed or hidden by setting the two passwords. This prevents erroneous operation or overwriting of function codes. In addition, if a wrong password was input exceeding the specified number of times, the inverter is restricted from operating as the user is regarded as improper.

## Fire mode (forced operation)

This mode ignores (retry) the inverter protection function to continue the operation. In that way, the inverter keeps operating the fan and pump as much as possible in case of emergency such as fire.

## Pick-up operation function

The pick-up operation function enables smooth starts. If you wish to run a fan currently not run by the inverter and in idle mode, this function searches the speed regardless of the direction of rotation and pick up the motion smoothly. This function allows for smooth operation such as when switching the power supply from the commercial power to inverter in a momentary action.

7

## **Standard Specifications**

#### 3-phase, 400V series (0.75 to 710kW)

Application		Item							Specifi	cations							
Marca	Model	FRN AR1 # -4E : FRENIC-	HVAC	0.75	1.5	2.2	4.0	5.5	7.5	11	15	18.5	22	30	37	45	55
Part	Applicable standard motor (rated output) [kW] *1			0.75	1.5	2.2	4.0	5.5	7.5	11	15	18.5	22	30	37	45	55
Mail power supply told phase, voltage frequency   Mail power supply told of phase, voltage frequency   Mail power supply told pha	Rated capacity [kVA] *2		1.9	3.1	4.1	6.8	10	14	18	24	29	34	45	57	69	85	
Min power spey fine of phase, voltage frequency   Min power spey fine of phase voltage frequency   Min power spey fine of	Voltage [V]*3			oltage [V] *3 3-phase, 380 to 480V (with AVR function)													
Min power spey fine of phase, voltage frequency   Min power spey fine of phase voltage frequency   Min power spey fine of	nt rat	Rated current [A]		2.5 4.1 5.5 9.0 13.5 18.5 24.5 32 39 45 60 75 91 112													
Min power spey fine of phase, voltage frequency   Min power spey fine of phase voltage frequency   Min power spey fine of	Jutpi	Overload current rating	110%-1min (Overload tolerated interval: compliant with IEC 61800-2)														
		Rated frequency [Hz]		· · · · · · · · · · · · · · · · · · ·													
Park	>	Main power supply (No. of phase, voltag	je, freguency)				3-pha	se, 380	to 440V	, 50Hz /	3-phase	e 390 to	480V, 6	60Hz			
Park	lddns	Control power supply auxiliary-input (No	o. of phase, voltage, freguency)					Sin	gle pha	se, 380 t	o 480V	, 50/60H	Ηz				
Park	wer	Voltage, frequency variations			Voltage	: +10 to	-15% (L	Inbaland	e rate b	etween p	hases is	within 2	2%)*4 F	requency	/: +5 to	-5%	
Park	ut Po	Rated input current [A]		1.6	3.0	4.3	7.4	10.3	13.9	20.7	27.9	34.5	41.1	55.7	69.4	83.1	102
Packing	dul	Required power supply capaci	ty [kVA]	1.2	2.1	3.0	5.2	7.2	9.7	15	20	24	29	39	49	58	71
Bod		Braking torque [%]*5			!			20	!	!		-		10 to	15	-	-
Part	Braking	DC braking			Braking	starting	freque	ncy: 0.0	to 60.0l	Hz, Braki	ng time	0.0 to	30.0s, Bı	raking le	vel: 0 to	60%	
## End the file of the file o	EMC filt	er (IEC/EN61800-3:2004)			Compli	ant with	EMC st	andard:	Emissio	n: 1st En	v. (Cate	gory C2)	/ Immu	nity: 1st	and 2nd	d Env.	
This image   The							E	Built-in (	IEC/EN6	1000-3-	2, IEC/E	N61000	-3-12)				
Mode	Compliant with Electrical Safety Standards			<u> </u>													
Mode    FRN	"#" Enclosure (IEC/EN60529)			IP21/IP55													
Mode    FRN	Cooling method			Natural cooling Fan cooling													
Mode    FRN	Weight/	Mass [kg]	IP21/IP55	10	10	10	10	10	10	18	18	18	18	23	23	50	50
Mode    FRN		Item		Specifications													
Rated capacity [kVA] -2   114   134   160   192   231   287   316   396   445   495   563   731   891   104   104   105   10				75	90	110	132	160			280	315	355	400	500	630	710
Voltage [V] **3   Rated current [A]   150   176   210   253   304   377   415   520   885   650   740   960   1170   120	Applicable standard motor (rated output) [kW] *1		75	90	110	132	160	200	220	280	315	355	400	500	630	710	
Rated frequency [Hz]   Same as 0.75   Compliant with Electrical Safety Standards   Sanguard (EC/EN660529)   IP21/IP55   70   70   No and power supply (Main power supply (No. of phase, voltage, freguency)   IP21/IP55   No and power supply (No. of phase, voltage, freguency)   IP21/IP55   Indicate supply (No. of voltage, freguency)   IP21/IP25   Indicate supply (No. of voltage, freg		Rated capacity [kVA] *2		114	134	160	192	231	287	316	396	445	495	563	731	891	1044
Rated frequency [Hz]   Same as 0.75   Compliant with Electrical Safety Standards   Sanguard (EC/EN660529)   IP21/IP55   70   70   No and power supply (Main power supply (No. of phase, voltage, freguency)   IP21/IP55   No and power supply (No. of phase, voltage, freguency)   IP21/IP55   Indicate supply (No. of voltage, freguency)   IP21/IP25   Indicate supply (No. of voltage, freg	ngs	Voltage [V] *3		3-phase, 380 to 480V (with AVR function)													
Rated frequency [Hz]   Same as 0.75   Compliant with Electrical Safety Standards   Sanguard (EC/EN660529)   IP21/IP55   70   70   No and power supply (Main power supply (No. of phase, voltage, freguency)   IP21/IP55   No and power supply (No. of phase, voltage, freguency)   IP21/IP55   Indicate supply (No. of voltage, freguency)   IP21/IP25   Indicate supply (No. of voltage, freg	ıt rati	Rated current [A]		150	176	210	253	304	377	415	520	585	650	740	960	1170	1370
Rated frequency [Hz]   Same as 0.75   Compliant with Electrical Safety Standards   Sanguard (EC/EN660529)   IP21/IP55   70   70   No and power supply (Main power supply (No. of phase, voltage, freguency)   IP21/IP55   No and power supply (No. of phase, voltage, freguency)   IP21/IP55   Indicate supply (No. of voltage, freguency)   IP21/IP25   Indicate supply (No. of voltage, freg	Jutpu	Overload current rating			l	1109	6-1min (	Overloa	d tolera	ted inter	val: con	npliant v	vith IEC	61800-	2)		
Control power supply auxiliary-input (No. of phase, voltage, freguency)  Voltage, frequency variations  Rated input current [A]  Required power supply capacity [kVA]  Braking  DC braking  EMC filter (IEC/EN61800-3:2004)  DC reactor (DCR)  Built-in  Standard accessory (IEC/EN61000-3-2, IEC/EN61000-3-12)  Tenclosure(IEC/EN60529)  Control power supply auxiliary-input (No. of phase, voltage, freguency)  Voltage, frequency Single phase, 380 to 480V, 50/60Hz  Voltage, frequency sis within 2%)'4 Frequency: +5 to -5%  Voltage, frequency in the sistency is within 2%)'4 Frequency: +5 to -5%  Voltage, frequency in the sistency is within 2%)'4 Frequency: +5 to -5%  Rated input current [A]  Required power supply capacity [kVA]  95 113 140 165 199 248 271 347 388 436 489 611 773 88  Braking torque [%]''5  DC braking  Braking starting frequency: 0.0 to 60.0Hz, Braking time: 0.0 to 30.0s, Braking level: 0 to 60%  EMC filter (IEC/EN61800-3:2004)  Same as 0.75 to 55kW  Compliant with EMC standard: Emission: 2nd Env. (Category C3) / Immunity: 1st and 2nd Env.		Rated frequency [Hz]								50, 60	Hz						
Control power supply auxiliary-input (No. of phase, voltage, frequency)   Single phase, 380 to 480V, 50/60Hz	>	Main power supply (No. of phase, voltag	je, freguency)	3-phase, 380 to 440V, 50Hz / 3-phase 390 to 480V, 60Hz													
Braking torque [%]**   DC braking   Braking torque [%]**   DC braking   Braking starting frequency: 0.0 to 60.0Hz, Braking time: 0.0 to 30.0s, Braking level: 0 to 60%	lddn	Control power supply auxiliary-input (No	o. of phase, voltage, freguency)														
Braking torque [%]**   DC braking   Braking torque [%]**   DC braking   Braking starting frequency: 0.0 to 60.0Hz, Braking time: 0.0 to 30.0s, Braking level: 0 to 60%	wer	Voltage, frequency variations		\	/oltage:	+10 to -	15% (Ur	balance	rate bet	ween ph	nases is v	vithin 29	%)*4 Fre	equency	+5 to -	5%	
Braking torque [%]**   DC braking   Braking torque [%]**   DC braking   Braking starting frequency: 0.0 to 60.0Hz, Braking time: 0.0 to 30.0s, Braking level: 0 to 60%	ut Pc	Rated input current [A]		136	162	201	238	286	357	390	500	559	628	705	881	1115	1256
Braking DC braking         Braking starting frequency: 0.0 to 60.0Hz, Braking time: 0.0 to 30.0s, Braking level: 0 to 60%           EMC filter (IEC/EN61800-3:2004)         Same as 0.75 to 55kW         Compliant with EMC standard: Emission: 2nd Env. (Category C3) / Immunity: 1st and 2nd Env. (DCR)         Built-in         Standard accessory (IEC/EN61000-3-2, IEC/EN61000-3-12)           Compliant with Electrical Safety Standards         UL508C, C22.2No.14, IEC/EN61800-5-1:2007           "#" Enclosure(IEC/EN60529)         IP21/IP55         IP21/IP55         Fan cooling           Weight/Mass [kg]         IP21/IP55         70         70         70         70         70         1         Image: Color of the color of t	n g	Required power supply capaci	ty [kVA]	95	113	140	165	199	248	271	347	388	436	489	611	773	871
Braking starting frequency: 0.0 to 60.0Hz, Braking time: 0.0 to 30.0s, Braking level: 0 to 60%		Braking torque [%]*5		10 to 15													
DC reactor (DCR)   Built-in   Standard accessory (IEC/EN61000-3-2, IEC/EN61000-3-12)	Braking	DC braking		Braking starting frequency: 0.0 to 60.0Hz, Braking time: 0.0 to 30.0s, Braking level: 0 to 60%													
DC reactor (DCR)   Built-in   Standard accessory (IEC/EN61000-3-2, IEC/EN61000-3-12)	EMC filter (IEC/EN61800-3:2004)					Comp	liant wit	h EMC s	tandard	: Emissic	n: 2nd I	Env. (Ca	tegory C	(3) / Imm	unity: 1	st and 2	nd Env.
"#" Enclosure(IEC/EN60529)         IP21/IP55         IP21/IP55         IP21/IP55         70         70         10	DC reactor (DCR)																
Cooling method         Fan cooling           Weight/Mass [kg]         IP21/IP55         70         70         10	Compliant with Electrical Safety Standards			UL508C, C22.2No.14, IEC/EN61800-5-1:2007													
Weight/Mass [kg]         IP21/IP55         70         70         10	"#" Enclosure(IEC/EN60529)			IP21/IP55 IP00													
	Cooling	method		Fan cooling													
1P00 62 64 94 98 129 140 245 245 245 330 530 5	Weight/	Mass [kg]	IP21/IP55	70	70												
			IP00			62	64	94	98	129	140	245	245	245	330	530	530


<sup>\*1)</sup> Applicable standard motors are the case of Fuji Electric's 4-pole standard motors.
\*2) The rated capacity indicates the case of 440V ratings.
\*3) Output voltage cannot exceed the power supply voltage.
\*4) Interphase voltage unbalance ratio [%] = (max. voltage [V] - min. voltage [V] )/3-phase average voltage [V] × 67 (See IEC61800-3.) When unbalance ratio is between 2 and 3% please use optional AC reactor (ACR).
\*5) Average braking torque obtained by use of a motor. (Varies with the efficiency of the motor)



## Outline drawing

Power supply	Applicable standard	Inverter model		Outs	ide dime	ensions	(mm)		N	Nounting	dimensi	ons (mm	)
voltage	motor (kW)	inverter model	View	W	Н	D	D1	D2	View	W1	W2	H1	H2
	0.75	FRN0.75AR1□-4E											
	1.5	FRN1.5AR1□-4E											
	2.2	FRN2.2AR1□-4E		150	465					115	17	451	
	4.0	FRN4.0AR1□-4E											
	5.5	FRN5.5AR1□-4E											
	7.5	FRN7.5AR1□-4E											
	11	FRN11AR1 □-4E				262	162	100					7
	15	FRN15AR1 □-4E	_	203	585	202	102	_	В			571	,
	18.5	FRN18.5AR1□-4E	A	203	203					158	22		
	22	FRN22AR1 □-4E								130			
	30	FRN30AR1 □-4E		203	203 645							631	
	37	FRN37AR1 □-4E		203	0.5							051	
3-phase	45	FRN45AR1 □-4E		265 73	736	284	184			180	42	716	12
400V	55	FRN55AR1 □-4E			,50							710	12
	75	FRN75AR1 □-4E		300	885	368	241	127		215		855	
	90	FRN90AR1 □-4E		300	003	300	2-11	127		213		033	
	110	FRN110AR1□-4E			740	315	135			430		710	
	132	FRN132AR1□-4E		530	740	212						710	
	160	FRN160AR1□-4E		550		20 250							
	200	FRN200AR1□-4E			1000							970	
	220	FRN220AR1□-4E			1000	360	180	100				970	15
	280	FRN280AR1□-4E	С					180	D	580	50		15
	315	FRN315AR1□-4E		680					U	300	30		
	355	FRN355AR1□-4E			1 400	4.40							
	400	FRN400AR1□-4E			1400	440	260	)		720		1370	
	500	FRN500AR1□-4E		880						720			
	630	FRN630AR1□-4E		1000	1550	500	313	313 186		900		1520	
	710	FRN710AR1□-4E		1000	1330	500	داد	100		300		1320	

Protective structure: M: IP21, L: IP55, S: IP00. Type of frame: up to 37 kW plastic enclosure and 45 kW and above metal enclosure.

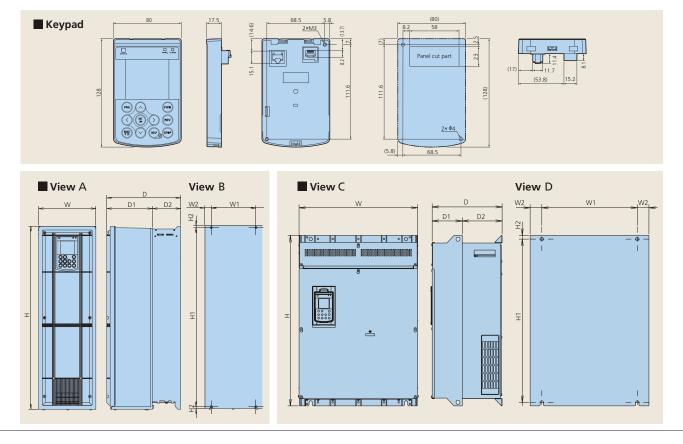

## **Wiring Diagram**

#### **Basic configuration diagram** (Factory shipped condition: with SOURCE mode input and enable input function) MCCB Magnetic contactor Main circuit part P(+) P(+) N(-) or ELCB (MC)Power supply 400V series L2/S 380V~480V 50/60Hz L3/T RΛ Controlpower AUXinput TO **G** Ground terminal Ground terminal RS-485 communications port 1 USB connector Control circuit part (RJ-45 connector for • keypad connection) SW3 30C Variable resistor 30B Alarm relay output +10VDC) 0V power supply (for any fault) 30A 12 Setting vo**l**tage input Contact point output (0~+10VDC) 11 Y5C AX terminal (0~ 10VDC) \_\_Y5A function Analog input Setting current input, PTC 4~20mADC During operation SW5 (0~20mADC) Y2 Frequency (speed) agreement Setting voltage input Y3 Frequency (speed) detection Transistor 0~ 10VDC Y4 +24VDC OV Motor overload prediction output Common terminal Enable input 1 (Shared between sink and source) EN2 Enable input 2 0~10VDC SINK 4~20mADC (0~20mADC) Analog meter SOURCE 0~10VDC FWD \*\* FM2 4~20mADC FWD operation/stop command REV \* \* (0~20mADC) REV operation/stop command SW6 CM Analog meter X1 \*\* -Multi-step frequency selection (0~1steps) Digital input **★**▼ X2 Multi-step frequency selection (0~3steps) ₹<del></del> ХЗ DX+ Self-hold selection **★**¥□ Data send/receive X4 DX-Coast-to-stop command \*\*= X5 Alarm reset X6 \*\* SW2 Frequency setting 2/frequency setting 1 SD X7 **★**¥→ Local (keypad) instruction selection RS-485 communications CM



## **Options**

#### Relay output interface card (OPC-RY)

This is an optional card that converts the transistor output at terminals Y1 to Y4 on the inverter body to relay output (1c). Each card has two relay outputs, and four relay outputs are available by installing two cards.

Note: When the card is mounted, the terminals Y1 to Y4 on the inverter body

2 circuits built-in Relay output:

Signal type: 1c

Contact point capacity: AC250V, 0.3A  $\cos \phi = 0$ . DC48V, 0.5A (Resistance load)

### Relay output interface card (OPC-RY2)

This optional card allows relay outputs (1a) to be added. When used in cascaded control, this card can control the seven motors.

\* By using the two relay outputs on the inverter body, max. 8 units and one unit (auxiliary pump) can be controlled.

Relay output: 7 circuits built-in

Signal type: 1a

Contact point capacity: AC250V, 0.3A  $\cos \phi = 0$ .

DC48V, 0.5A (Resistance load)

#### Analog input interface card (OPC-AIO)

This card allows analog input and output to be used.

Analog input: 1 analog voltage input point (0~±10V)

1 analog current input point (4~20mA) Analog output: 1 analog voltage output point (0~±10V)

1 analog current output point (4~20mA)

#### Analog current output interface card (OPC-AO)

This card allows two analog current output (4 to 20mA) points to be used. The card cannot be used together with OPC-AIO.

#### CC-Link communications card (OPC-CCL)

By connecting this card with the CC-Link master unit, the communications rate up to 10Mbps can be supported and the transmission distance is covered up to 1200 m in total.

Communications method: CC-Link Ver1.10 and Ver2.0

Communications rate: 156kbps~

#### DeviceNet communications card (OPC-DEV)

This card enables operation instruction and frequency command to be set from the DeviceNet master, allowing operation conditions to be monitored and all the function codes to be changed and checked.

No. of connection nodes: max. 64 units (including the master unit)

MAC ID: 0~63

Insulation: 500V DC (photocoupler insulation) Communications rate: 500kbps/250kbps/125kbps Network consumed power max. 80mA, 24V DC

#### PROFIBUS DP communications card (OPC-PDP2)

This card enables operation instruction and frequency command to be set from the PROFIBUS DP master, allowing operation conditions to be monitored and all the function codes to be changed and checked.

Communications rate: 9.6kbps~12Mbps Connection connector: 6-pole terminal block

#### CANopen communications card (OPC-COP)

This card enables operation instruction and frequency command to be set from the CANopen master (such as PC and PLC), allowing all the function codes to be set and checked.

No. of connection nodes 127 units

**Communications rate:** 20k, 50k, 125k, 250k, 500k, 800k, 1Mbps

Transmission distance: ~2,500m

#### LonWorks communications card (OPC-LNW)

This card allows peripheral equipment (including a master unit) that is connected via LonWorks to be connected with the inverter, enabling operation instruction and frequency command to be set from the master unit

#### Ethernet communications card (OPC-ETH)

Mounting the communications card OPC-ETH on the FRENIC-HVAC enables the user to control the FRENIC-HVAC as a slave unit by configuring and monitoring run and frequency commands and accessing inverter's function codes from the Ethernet master.

#### Pt100 temperature sensor input card (OPC-PT)

This product is a 2-channels resistance temperature detectors input card which can be equipped to FRENIC-HVAC series. This interface card allows the resistance temperature detector (hereafter RTD) to be directly connected without converters to the inverter and convert a temperature values into a digital value. Applicable RTD are "JPt100", "Pt100", "Ni100", "Pt1000", and "Ni1000".

#### Battery (OPK-BP)

Used for the real time clock activated while the inverter power is off. The real time clock can be operated even when no power is supplied inverter at electric power interruption.

#### Extension cable for remote operation (CB- S)

This cable is used in connection between the inverter body and the keypad.

Optional type	Length (m)
CB-5S	5
CB-3S	3
CB-1S	1



### Innovating Energy Technology

European Headquarters

#### Fuji Electric Europe GmbH

Goethering 58 63067 Offenbach/Main Germany

Tel.: +49 (0) 69 669029 0 Fax: +49 (0) 69 669029 58 info\_inverter@fujielectric.de

www.fujielectric.de

Japanese Headquarters

#### Fuji Electric Co., Ltd.

Gate City Ohsaki East Tower, 11-2 Osaki 1-chome, Shinagawa-ku, Chuo-ku Tokyo 141-0032 Japan

Tel: +81 (0) 3 5435 7280 Fax: +81 (0) 3 5435 7425 www.fujielectric.com

#### France

#### Fuji Electric Europe GmbH

265 Rue Denis Papin 38090 Villefontaine

Tel.: +33 (0) 4 74 90 91 24 Fax: +33 (0) 4 74 90 91 75 info.france@fujielectric.de www.fujielectric.de

#### Spain

#### Fuji Electric Europe GmbH Sucursal en España

Rda. Can Fatjo, 5 edif. D local B Parc Tecnològic del Vallès

08290 Cerdanyola del Vallès (Barcelona)

Tel.: +34 (0) 935 824 333 Fax. +34 (0) 935 824 344 infospain@fujielectric.de www.fujielectric.de

#### Italy

#### Fuji Electric Europe GmbH

Via Rizzotto 46 41126 Modena (MO) Tel.: +39 059 4734 266 Fax: +39 059 4734 294 info.italy@fujielectric.de

#### Switzerland

#### Fuji Electric Europe GmbH

Park Altenrhein 9423 Altenrhein

www.fujielectric.de

Tel.: +41 (0) 71 858 29 49 Fax: +41 (0) 71 858 29 40 info@fujielectric.ch www.fujielectric.de

#### United Kingdom

#### Fuji Electric Europe GmbH

Tel.: +44 (0) 7989 090 783 info\_inverter@fujielectric.de www.fujielectric.de